

Limited Warranty & Limitation of Liability

SEAWARD Electronic Limited guarantees this product to be free from defects in material and workmanship under normal use and service for a period of 1 year. The period of warranty will be effective at the day of delivery.

(c) Copyright 2009

All rights reserved. Nothing from this edition may be multiplied, or made public in any form or manner, either electronically, mechanically, by photocopying, recording, or in any manner, without prior written consent from SEAWARD Electronic Limited. This also applies to accompanying drawings and diagrams.

Due to a policy of continuous development SEAWARD Electronic Limited reserves the right to alter the equipment specification and description outlined in this publication without prior notice and no part of this publication shall be deemed to be part of any contract for the equipment unless specifically referred to as an inclusion within such contract.

DECLARATION OF CONFORMITY

As the manufacturer of the apparatus listed, declare under our sole responsibility that the product:

AGL-5 Airfield Ground Lighting Tester

To which this declaration relates are in conformity with the relevant clauses of the following standard:

BS EN 61243-2:1998

BS EN 61243-3:1999

BS EN 61326:1998

Electrical equipment for measurement, control and laboratory user-EMC Requirements

Performance: The instrument operates within specification when used under the conditions in the above standards EMC and Safety Standards.

The product identified above conforms to the requirements of Council Directive 89/336/EEC and 73/23 EEC.

Seaward Electronic Ltd is registered under BS EN ISO9001:2000 Certificate No: Q05356.

1 Important Information

These operating instructions are intended for the use of adequately trained personnel.

Before use, ensure that the AGL-5 tester is clean and dry; visually inspect all parts. Any damage must be rectified prior to use.


Never hold an AGL-5 Tester between the hand-guard and the contact electrode.

Always prove the AGL-5 Tester before AND after use.

1. Holding the AGL-5 tester by the handles, behind the handguards, connect the instrument to a Seaward PH3-LLT proving unit and verify that the LED indicators are illuminated.
2. Holding the AGL-5 tester by the handles, behind the handguards, place the contact electrodes in contact with the circuit under test.
3. If the LED indicators are illuminated there is a voltage greater than the threshold voltage present at the probe tips.
4. If the LED indicators do not illuminate any voltage present at the probe tips is less than the threshold voltage.
5. Repeat step 1 above to verify that the instrument is still operational.

2 Proving

- Connect the one probe to the BLACK terminal.
- Connect the other probe to the RED terminal.
- Press the probe down onto the RED terminal as shown below to operate the internal micro-switch.
- Confirm that the neon illuminates indicating the test voltage is active.
- Confirm that the LED indicators in the AGL-5 illuminate.
- Disconnect both probes from the proving unit.

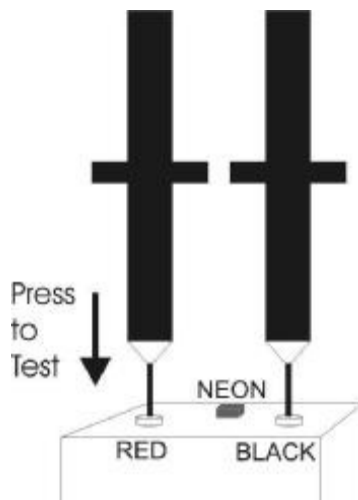

3 Specifications

Maximum Working Voltage	5000V AC/DC
Threshold voltage	50V AC / 70V DC
Operating Current	<3.5mA AC/DC at max working voltage
Indicator	High intensity LED with polarizing filter
Handle length	160mm
Overall Length	530mm
Probe tip length	38mm
Hand guard height	>10mm over 70% circumference
Length of insulation between contact electrode and hand-guard	574mm
Un-insulated contact electrode length	5mm
Contact Electrode diameter	3mm
Lead length between probes	0.8m triple insulated cable
Construction	High Impact, total encapsulation
Compliance	BS EN 61243-2:1998